


REF. STANDARD DETAILS FOR
CONCRETE SIDEWALK

3/4" EXPANSION BOARD
SELF LEVELING SEALANT

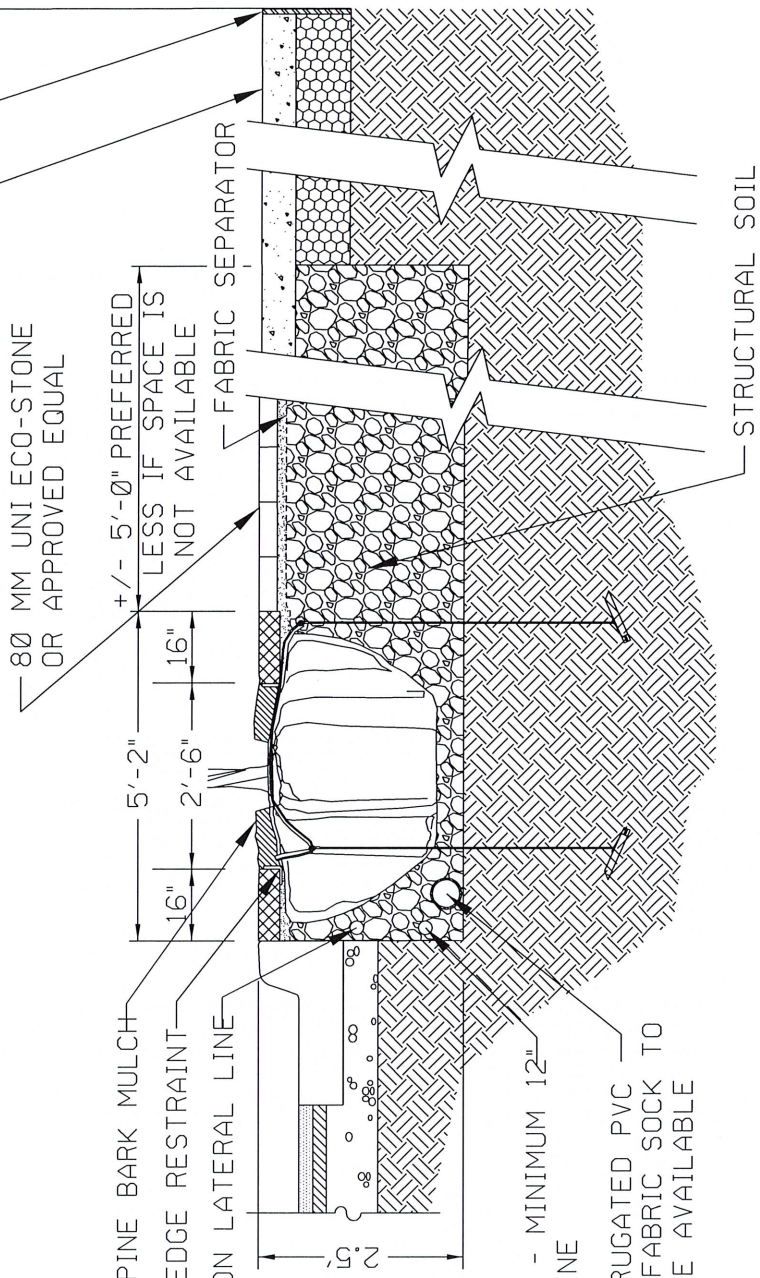

80 MM UNI ECO-STONE
OR APPROVED EQUAL

+/- 5'-0" PREFERRED
LESS IF SPACE IS
NOT AVAILABLE

5'-2"

16"

2'-6"

SHREDDED CYPRESS OR PINE BARK MULCH

EDGE RESTRAINT

IRRIGATION LATERAL LINE

ELECTRICAL CONDUIT - MINIMUM 12"

BELOW IRRIGATION LINE

4" PERFORATED, CORRUGATED PVC
UNDER DRAIN WITH FABRIC SOCK TO
STORM SEWER WHERE AVAILABLE

STRUCTURAL SOIL

STRUCTURAL SOIL

NOTE:

1. REFER TO PLANS FOR LIMITS OF STRUCTURAL SOIL.
2. WATERPROOFING REQUIRED IF BASEMENT IS UNDER SIDEWALK.

STRUCTURAL SOIL	
CITY OF TULSA, OKLAHOMA ENGINEERING SERVICES DEPARTMENT	
DRAWN BY: R.M.I.O.	APPROVED:
CHECKED BY: <i>HH</i>	<i>[Signature]</i>
DATE: MARCH 2022	STANDARD NO. 831
NOT TO SCALE	