


STRUCTURAL SOIL REF TO STANDARD #831

PIPE SHALL BE LEVEL, TOP OF PIPE SHALL BE SET DIRECTLY BELOW GEOTEXTILE SEPARATOR FABRIC AT LOWEST PAVEMENT ELEVATION WITHIN THE PLANTER


CONCRETE CURB



4" SCHEDULE 40 PVC PIPE


RISER PIPE WITH REMOVABLE CAP CAP SHALL BE FLUSH WITH PAVERS

1/4" DIAMETER DRAINAGE HOLES DRILLED IN BOTTOM OF PIPE AT 12" O.C.

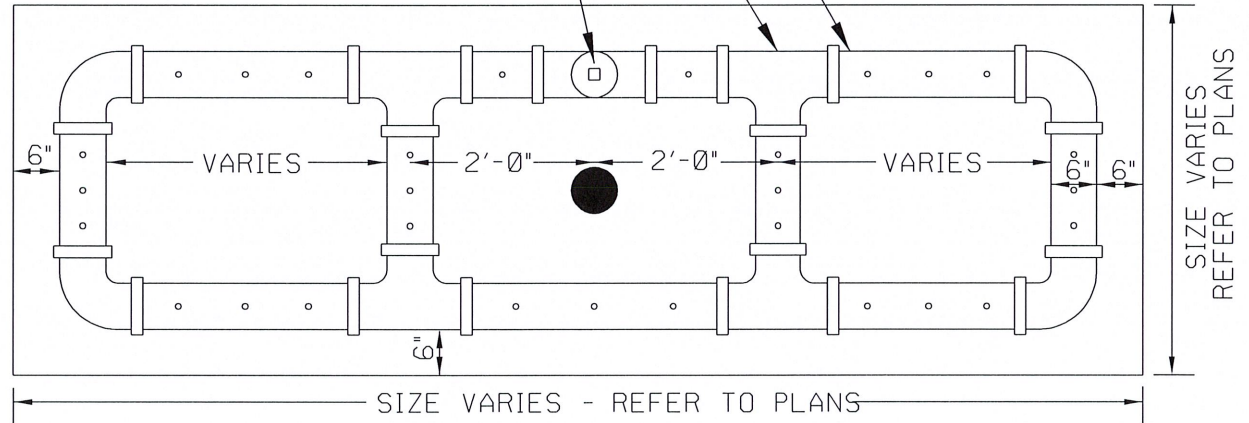

EXISTING SIDEWALK

NOTE:
REFER TO PLANS FOR LOCATION OF PLANTER IN RELATION TO CURB.

MANUAL TREE IRRIGATION	
CITY OF TULSA, OKLAHOMA ENGINEERING SERVICES DEPARTMENT	
DRAWN BY: R.M.O. CHECKED BY: <i>HAS</i> DATE: MARCH 2022	APPROVED: 
NOT TO SCALE	STANDARD NO. 849