


TYPICAL FIRE HYDRANT INSTALLATION

NOTE: HYDRANT DRAIN MUST BE LEFT CLEAN AFTER POURING CONCRETE BLOCKING.

RESTRAINING GLANDS MAY BE USED IN LIEU OF CONCRETE BLOCKING.

ISOLATION VALVES REQUIRED FOR FIRE HYDRANTS IN ARTERIAL CORRIDORS.

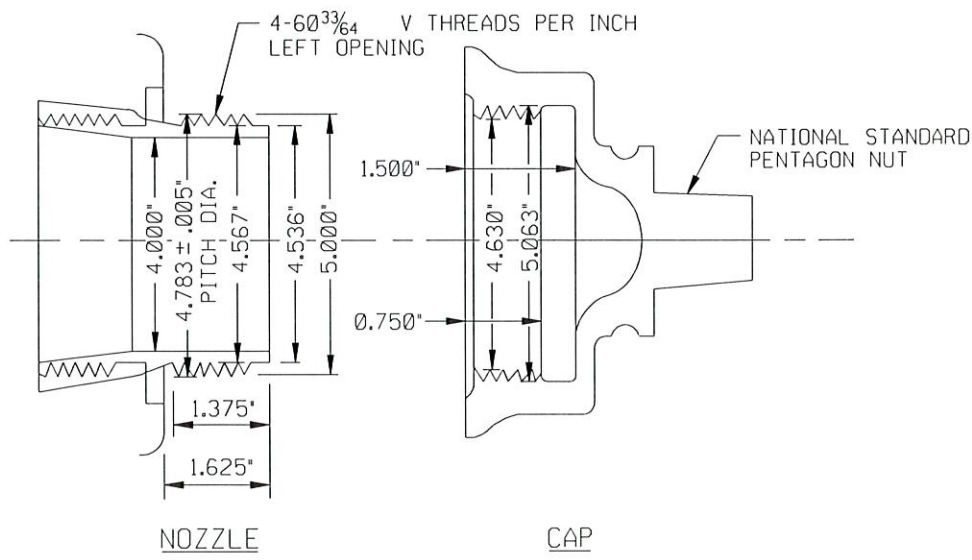

TULSA STANDARD THREADS - PUMPER NOZZLE

STANDARD DETAIL FIRE HYDRANT	
CITY OF TULSA, OKLAHOMA ENGINEERING SERVICES DEPARTMENT	
DRAWN BY: J.B.H. CHECKED BY: <i>HAS</i> DATE: MARCH 2023	APPROVED <i>[Signature]</i>
NOT TO SCALE	STANDARD NO. 309

PATH NAME: /E1/PARTS/STD/DCN.STDS/309-FIRE-HYDRANT.DGN JBH 03/13/2023