
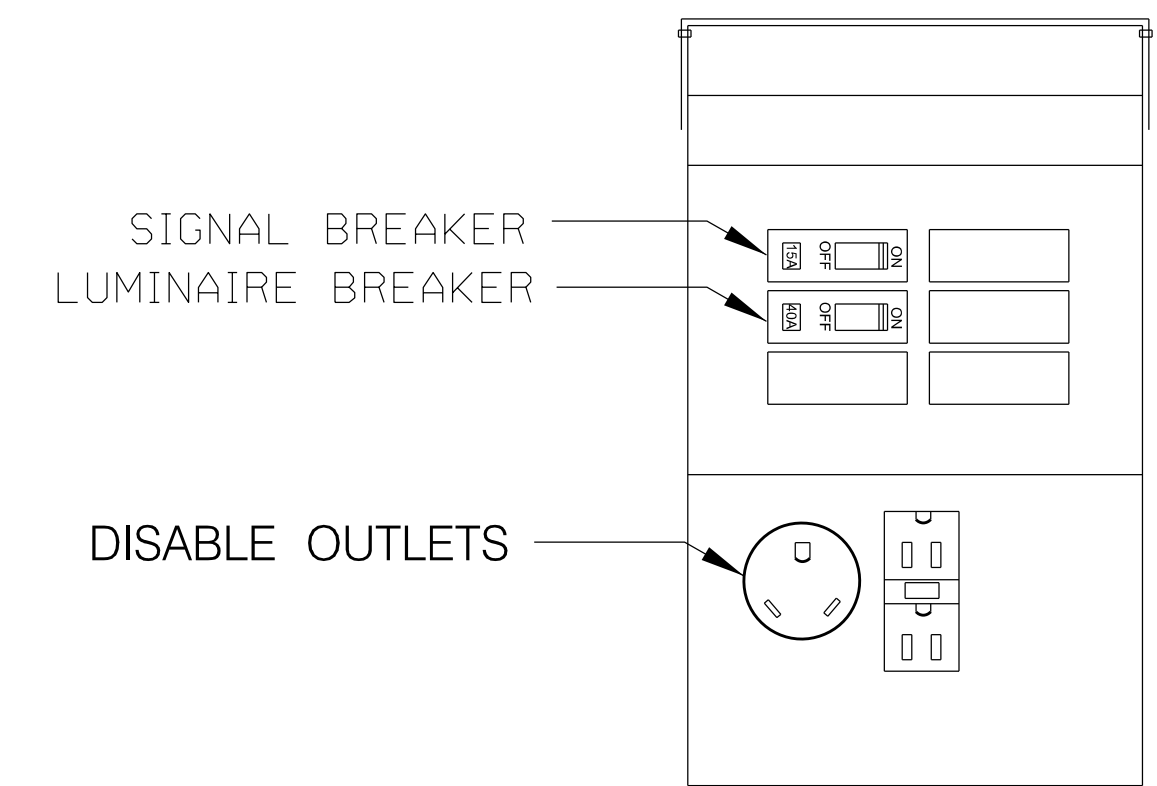


NOTE:
 (2) 58"x 8' COPPER CLAD
 GROUND RODS SPACED 6FT
 APART ARE REQUIRED FOR
 ALL SERVICES. #4 BARE
 COPPER WIRE SHALL BE
 BONDED AND CONNECTED
 FROM SERVICE TO EACH
 GROUND ROD.

PEDESTAL SERVICE INSTALLATION - SECTION A-A

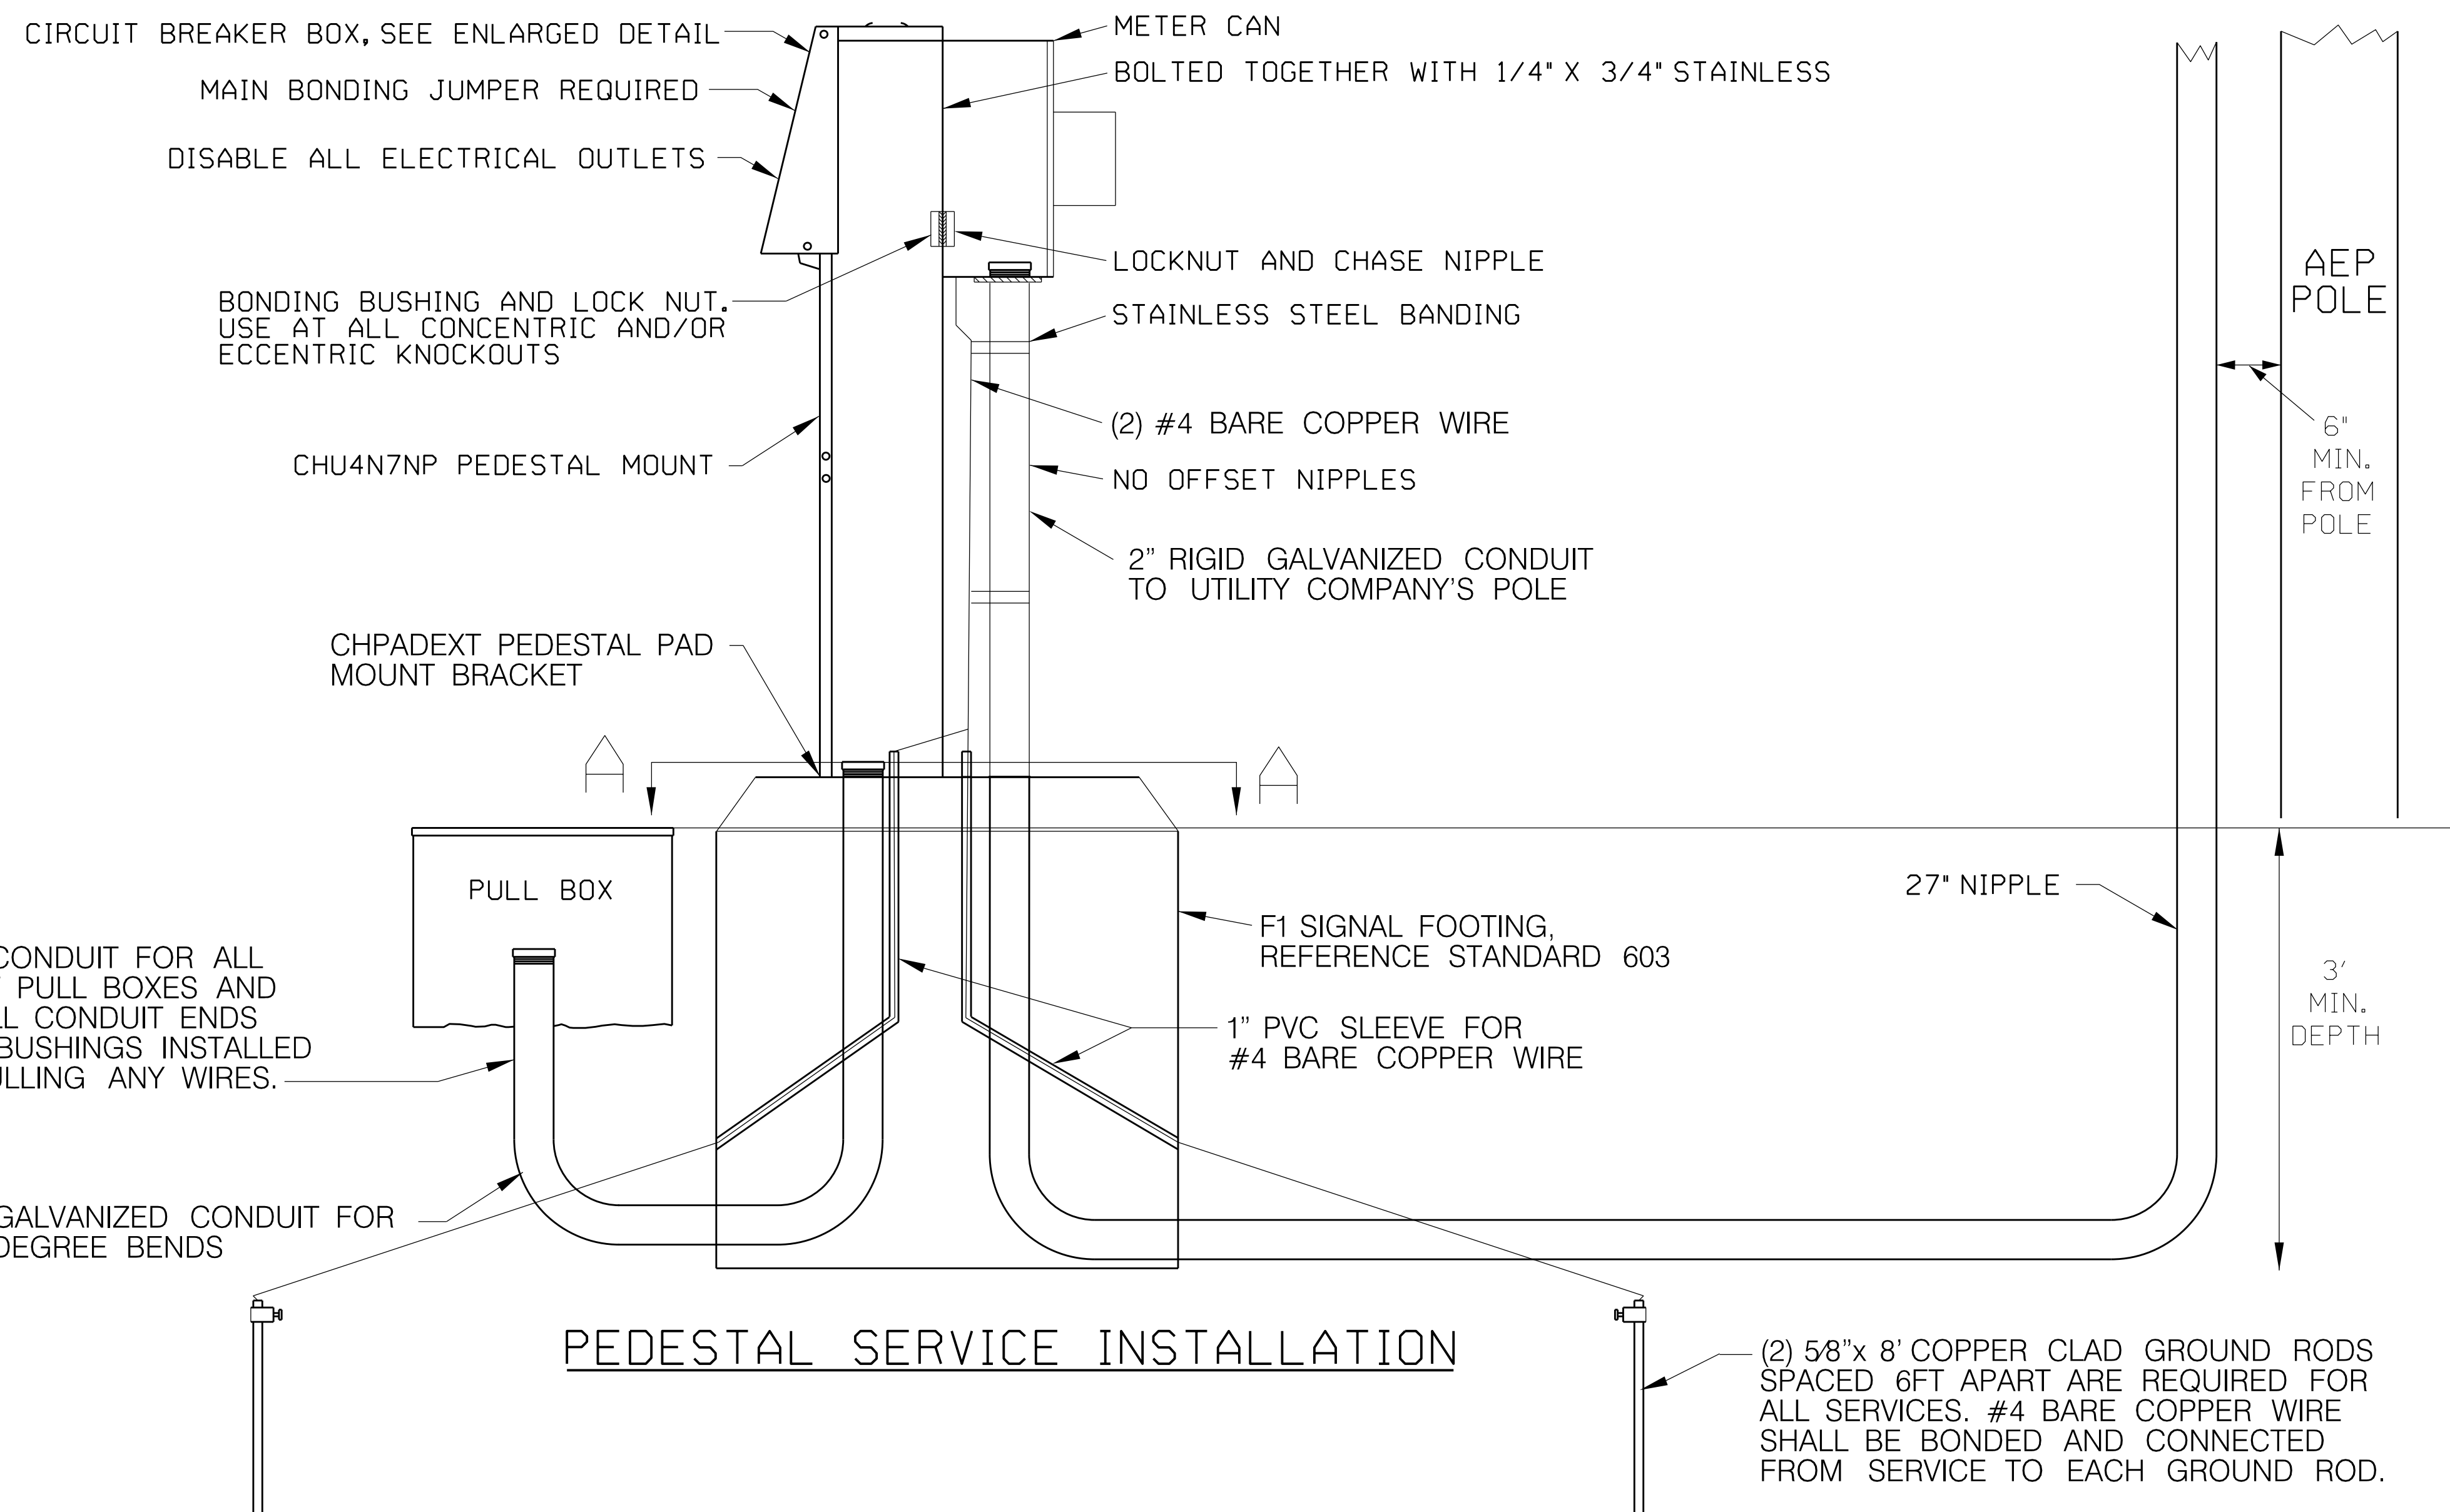

NOTE:
 LABELS SHALL BE ADDED FOR
 ALL SERVICE DISCONNECTS

CIRCUIT BREAKER BOX AND
 SERVICE DISCONNECTS

TYPICAL:
 USE 2" PVC CONDUIT FOR ALL
 STUB UPS AT PULL BOXES AND
 FOOTINGS. ALL CONDUIT ENDS
 SHALL HAVE BUSHINGS INSTALLED
 PRIOR TO PULLING ANY WIRES.

TYPICAL:
 USE 2" GALVANIZED CONDUIT FOR
 ALL 90 DEGREE BENDS

(2) 58"x 8' COPPER CLAD GROUND RODS
 SPACED 6FT APART ARE REQUIRED FOR
 ALL SERVICES. #4 BARE COPPER WIRE
 SHALL BE BONDED AND CONNECTED
 FROM SERVICE TO EACH GROUND ROD.

REVISION	BY	DATE

CITY ENGINEER	CITY OF TULSA, OKLAHOMA	
	TRAFFIC SIGNAL PEDESTAL SERVICE	
CITY TRAFFIC ENGINEER	DATE: OCTOBER 2024	STD. 607B