



PUBLIC WORKS
Engineering

DATE: October 08, 2024

TO: PAUL ZACHARY P.E.,
PUBLIC WORKS DEPUTY
DIRECTOR

FROM: H. SOMDECERFF,
PUBLIC WORKS DESIGN
MANAGER

Standards and Specifications for Sanitary Sewer Long Service.

The Specification Review Committee recommends and asks the Public Works Deputy Director to approve the following:

1. Approve Standard Detail No. 607B - Traffic Signal Pedestal Service.

Please call me at (918) 596-7355 If you have any questions.

Thank you,

APPROVED:



Paul Zachary P.E., Deputy Director


10.11.24

Date

Cc: Engineering Services Department Specification Review Committee


1896 * 1898

TUL * USA

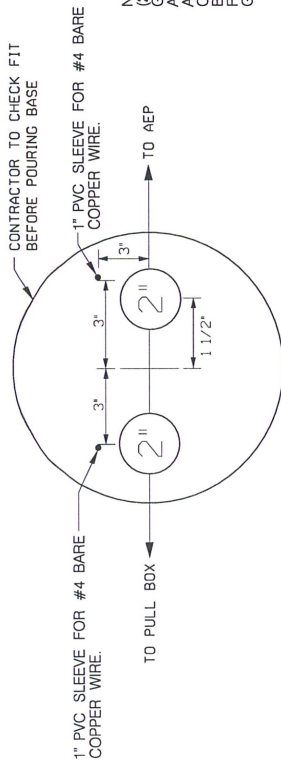

NOTE:
 (2) 5/8"x 8" COPPER CLAD
 GROUND RODS SPACED 6FT
 APART ARE REQUIRED FOR
 ALL SERVICES. #4 BARE
 COPPER WIRE SHALL BE
 BONDED AND CONNECTED
 FROM SERVICE TO EACH
 GROUND ROD.

PEDESTAL SERVICE INSTALLATION - SECTION A-A

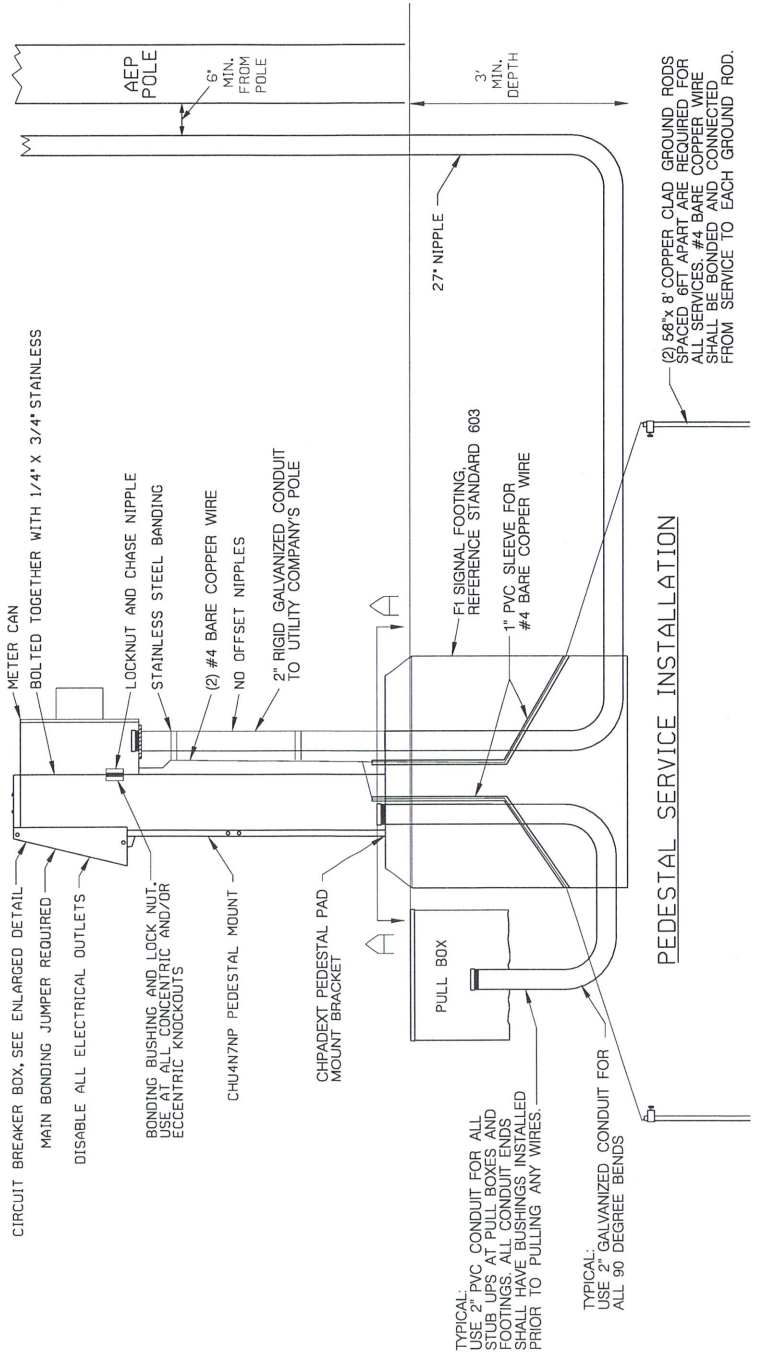


TYPICAL:
 USE 2" PVC CONDUIT FOR ALL
 STUB UPS AT PULL BOXES AND
 FOOTINGS. ALL CONDUIT ENDS
 SHALL HAVE BUSHINGS INSTALLED
 PRIOR TO PULLING ANY WIRES.

TYPICAL:
 USE 2" GALVANIZED CONDUIT FOR
 ALL 90 DEGREE BENDS

PEDESTAL SERVICE INSTALLATION

(2) 5/8"x 8" COPPER CLAD GROUND RODS SPACED 6FT APART ARE REQUIRED FOR ALL SERVICES. #4 BARE COPPER WIRE SHALL BE BONDED AND CONNECTED FROM SERVICE TO EACH GROUND ROD.

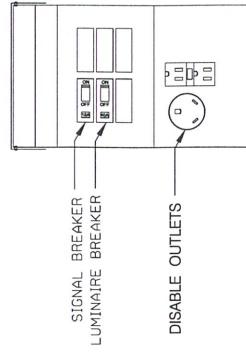

NOTE:
 LABELS SHALL BE ADDED FOR
 ALL SERVICE DISCONNECTS

**CIRCUIT BREAKER BOX AND
 SERVICE DISCONNECTS**

REVISION	BY	DATE

CITY ENGINEER _____

CITY OF TULSA, OKLAHOMA

CITY TRAFFIC ENGINEER _____

TRAFFIC SIGNAL PEDESTAL SERVICE

DATE: OCTOBER 2024

STD. 607B